



PHONE: (303) 442-1255 • FAX: (970) 535-3114 • E-MAIL: itl@itlboulder.com • WEBSITE: www.itlboulder.com

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 1 OF 6

ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC

ADDRESS: 4539 WELLINGTON ROAD
BOULDER, CO 80301

CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

LUMINAIRE: EXTRUDED WHITE PAINTED HOUSING, FABRICATED WHITE PAINTED METAL TOP/REFLECTOR, 24 WHITE CIRCUIT BOARDS EACH WITH 48 LEDS, WHITE FABRIC DIFFUSER.

LAMPS: ONE THOUSAND ONE HUNDRED FIFTY-TWO WHITE LIGHT EMITTING DIODES (LEDS), VERTICAL BASE-UP POSITION.

INPUT ELECTRICAL: 120.0 VOLTS, 164.3 WATTS, 1.37 AMPS


MOUNTING: RECESSED

LED DRIVERS: TWO OSRAM OTi 85/120-277/2A3 DIM L, DRIVERS HAVE MULTIPLE LEADS, ONLY LINE INPUT AND LED OUTPUT LEADS CONNECTED FOR THIS TEST, CLIENT STATES EACH DRIVER PROGRAMMED FOR 1650mA OUTPUT.

NOTE: DATA SHOWN IS ABSOLUTE FOR THE SAMPLE PROVIDED AT RATED INPUT VOLTAGE (120VAC, 60Hz) TO THE DRIVERS.

TEST PROCEDURE: IESNA LM-79-08

TEST DISTANCE = 35.0 FEET

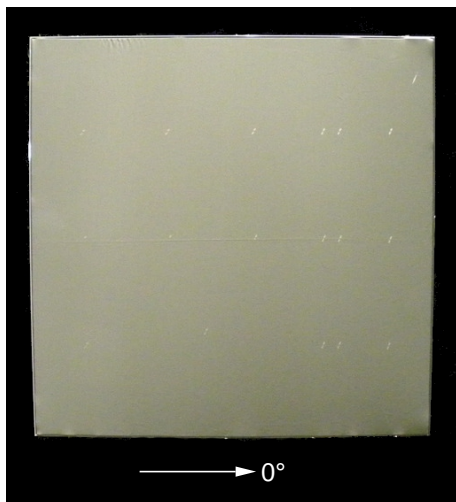

THIS REPORT WITH THE USE OF THE NVLAP LOGO SHALL NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NVLAP, NIST, OR ANY AGENCY OF THE FEDERAL GOVERNMENT.

Approved *C STOUT*

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 2 OF 6

ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC


CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

CANDELA DISTRIBUTION						FLUX
	0.0	22.5	45.0	67.5	90.0	
0	5052	5052	5052	5052	5052	
5	5029	5034	5030	5033	5031	478
15	4854	4861	4858	4860	4855	1371
25	4512	4520	4518	4521	4517	2082
35	4015	4026	4025	4027	4024	2518
45	3397	3399	3401	3405	3399	2623
55	2670	2667	2670	2674	2669	2386
65	1868	1869	1868	1872	1867	1851
75	1052	1058	1050	1054	1059	1116
85	294	303	297	301	302	338
90	0	0	0	0	0	

ZONAL LUMEN SUMMARY		
ZONE	LUMENS	%FIXT
0- 30	3931	26.6
0- 40	6450	43.7
0- 60	11460	77.6
0- 90	14765	100.0
90-180	0	0.0
0-180	14765	100.0

EFFICACY = 89.9 lm/W
 CIE TYPE - DIRECT
 PLANE : 0-DEG 90-DEG
 SPACING CRITERIA : 1.26 1.26
 BEAM ANGLE (50%) : 113.6 X 113.7 DEGREES
 FIELD ANGLE (10%) : 164.2 X 164.2 DEGREES
 LUMINOUS LENGTH : 47.250 47.250

LUMINANCE DATA IN CANDELA/SQ M			
ANGLE IN DEG	AVERAGE 0-DEG	AVERAGE 45-DEG	AVERAGE 90-DEG
45	3335.	3339.	3337.
55	3232.	3232.	3231.
65	3069.	3069.	3067.
75	2822.	2817.	2841.
85	2342.	2366.	2406.

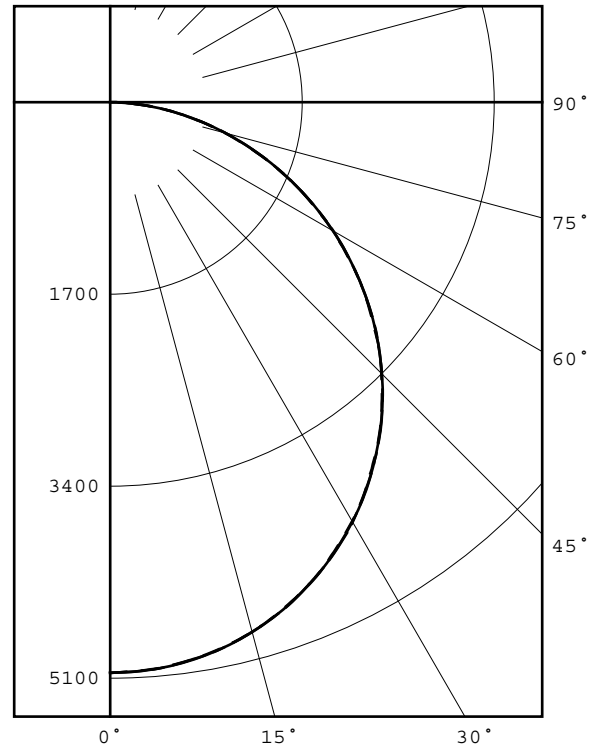

LEGEND
 0-deg - - - - -
 45-deg _____
 90-deg



INDEPENDENT TESTING LABORATORIES, INC.
4066 CAMELOT CIRCLE, LONGMONT, CO 80504 USA

PHONE: (303) 442-1255 • FAX: (970) 535-3114 • E-MAIL: itl@itlboulder.com • WEBSITE: www.itlboulder.com

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 3 OF 6

ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC

CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

CANDELA DISTRIBUTION
LATERAL ANGLE

	0.0	22.5	45.0	67.5	90.0
0.0	5052	5052	5052	5052	5052
2.5	5042	5049	5047	5049	5045
5.0	5029	5034	5030	5033	5031
7.5	5000	5006	5004	5006	4999
10.0	4961	4967	4966	4967	4964
12.5	4913	4918	4916	4919	4915
15.0	4854	4861	4858	4860	4855
17.5	4784	4793	4788	4790	4786
20.0	4702	4710	4707	4710	4708
22.5	4614	4618	4617	4621	4614
25.0	4512	4520	4518	4521	4517
27.5	4399	4409	4405	4409	4410
30.0	4285	4291	4289	4294	4293
32.5	4161	4165	4165	4163	4158
35.0	4015	4026	4025	4027	4024
37.5	3874	3881	3880	3884	3881
40.0	3724	3728	3727	3735	3732
42.5	3561	3566	3571	3571	3569
45.0	3397	3399	3401	3405	3399
47.5	3228	3229	3228	3236	3229
50.0	3038	3045	3047	3047	3052
52.5	2858	2862	2866	2862	2863
55.0	2670	2667	2670	2674	2669
57.5	2469	2472	2475	2482	2477
60.0	2273	2274	2276	2278	2281
62.5	2067	2076	2078	2076	2075
65.0	1868	1869	1868	1872	1867
67.5	1659	1665	1667	1671	1667
70.0	1458	1460	1466	1461	1459
72.5	1249	1261	1257	1257	1258
75.0	1052	1058	1050	1054	1059
77.5	859	856	857	856	856
80.0	661	663	669	667	659
82.5	477	478	479	478	477
85.0	294	303	297	301	302
87.5	132	134	134	135	134
90.0	0	0	0	0	0



INDEPENDENT TESTING LABORATORIES, INC.
4066 CAMELOT CIRCLE, LONGMONT, CO 80504 USA

PHONE: (303) 442-1255 • FAX: (970) 535-3114 • E-MAIL: itl@itlboulder.com • WEBSITE: www.itlboulder.com

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 4 OF 6

ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC

CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

5-DEGREE
ZONAL LUMEN SUMMARY

0- 5	121
5- 10	358
10- 15	583
15- 20	788
20- 25	968
25- 30	1114
30- 35	1225
35- 40	1294
40- 45	1320
45- 50	1303
50- 55	1243
55- 60	1143
60- 65	1008
65- 70	843
70- 75	657
75- 80	459
80- 85	261
85- 90	78

10-DEGREE
ZONAL LUMEN SUMMARY

0- 10	478
0- 20	1849
0- 30	3931
0- 40	6450
0- 50	9073
0- 60	11460
0- 70	13310
0- 80	14426
0- 90	14765



PHONE: (303) 442-1255 • FAX: (970) 535-3114 • E-MAIL: itl@itlboulder.com • WEBSITE: www.itlboulder.com

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 5 OF 6

ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC

CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

EFFECTIVE FLOOR CAVITY REFLECTANCE 0.20

RC	80				70				50			30			10			0	
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	94	97	94	91	93	90	88	89	87	85	83	83
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69	69
3	90	79	70	64	87	77	69	63	74	68	62	71	66	61	69	64	60	58	58
4	82	70	61	54	80	68	60	53	66	59	53	63	57	52	61	56	51	49	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42	42
6	69	56	47	40	68	55	46	40	53	45	40	51	45	39	50	44	39	37	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33	33
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	36	31	29	29
9	56	42	34	28	55	42	34	28	41	33	28	40	33	28	39	32	28	26	26
10	52	39	31	26	51	39	31	26	38	30	26	37	30	25	36	30	25	24	24

ALL CANDELA, LUMENS, LUMINANCE, AND VCP VALUES IN THIS REPORT ARE BASED ON ABSOLUTE PHOTOMETRY. THE COEFFICIENT OF UTILIZATION VALUES ARE BASED ON THE TOTAL ABSOLUTE LUMEN OUTPUT OF THIS TEST SAMPLE.

REPORT NUMBER: ITL90617-GONIOPHOTOMETRY

PAGE: 6 OF 6


ISSUE DATE: 07/13/18

PREPARED FOR: SOFTFORM LIGHTING, LLC

CATALOG NUMBER: SFR44 9/16 HTW HO 40 MVOLT

CONE OF LIGHT DIAGRAM

(diameter shown is where fc/lux value is half the fc/lux at nadir)

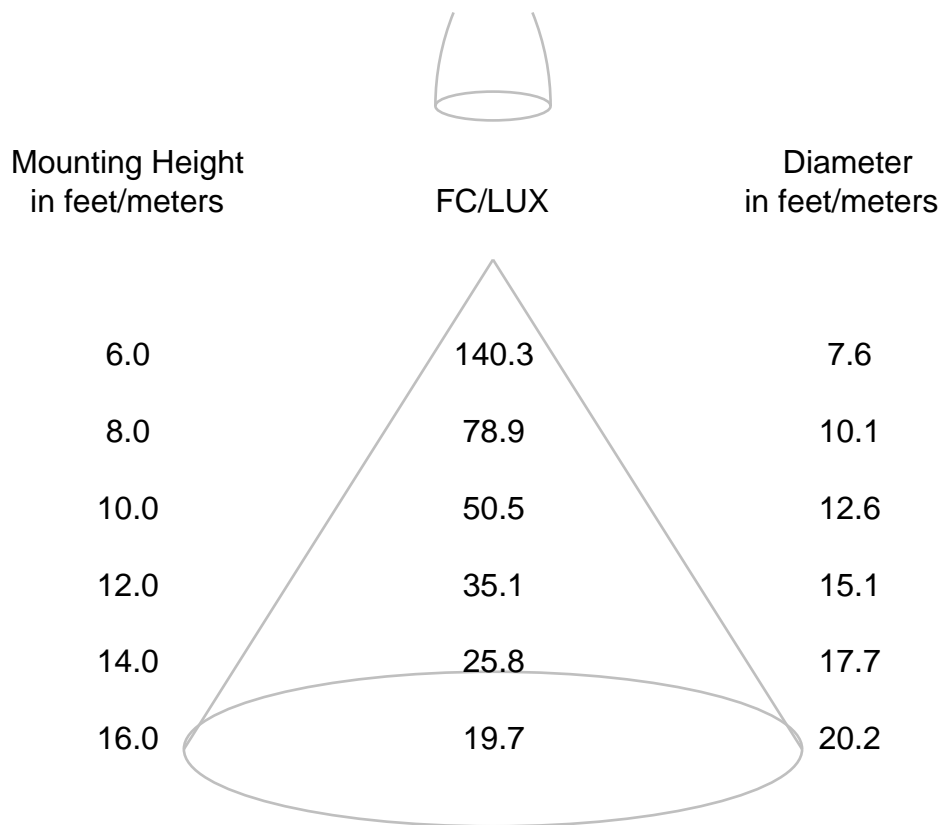

If distances are feet, results are footcandles.
If distances are meters, results are lux.

Note: The candela values used to generate this diagram were obtained by averaging the photometric data into a single plane.